

Government of India/ भारत सरकार
Department of Atomic Energy/ परमाणु ऊर्जा विभाग
Variable Energy Cyclotron Centre/ परिवर्तनीय ऊर्जा साइक्लोट्रॉन केंद्र
1/AF Bidhan Nagar, Kolkata 700064 / 1/ए एफ बिधान नगर, कोलकाता 700064

Notice inviting e-tender
ई-निविदा आमंत्रित करने के सूचना

Director, VECC, 1/AF Bidhan Nagar, Kolkata 700064 on behalf of the President of India invites online item rate tender (in two part) from reputed, qualified, experienced, technically and financially sound agencies for the following work :

Supply installation of Electrical distribution panels for SCC LCW system in VECC.

निदेशक, वीईसीसी, 1/एएफ बिधान नगर, कोलकाता 700064 भारत के राष्ट्रपति की ओर से निम्नलिखित कार्य के लिए प्रतिष्ठित, योग्य, अनुभवी, तकनीकी और वित्तीय रूप से मजबूत एजेंसियों से ऑनलाइन आइटम दर निविदा (दो बोली में) आमंत्रित करता है:

वीईसीसी में एससीडब्ल्यू प्रणाली के लिए विद्युत वितरण पैनलों की आपूर्ति स्थापना।

PART-A	NIT DETAILS
PART-B	GUIDELINES FOR e-TENDERING
PART-C	TENDER REQUIREMENTS FOR ELIGIBILITY
PART-D	GENERAL CONDITIONS OF CONTRACT
PART-E	SPECIFICATIONS & OTHER CONDITIONS
PART-F	SALIENT GOVERNING FEATURES OF THE WORK

Note :

The tender documents are bilingual. Hindi version of the document can be viewed properly only if Hindi fonts are installed properly in the computer. In case of difficulty in seeing the hindi fonts properly, the bidders are advised to install the hindi language front in their computer.

निविदा दस्तावेज अंग्रेजी और हिंदी में हैं। दस्तावेज का हिंदी संस्करण ठीक से तभी देखा जा सकता है जब कंप्यूटर में हिंदी फोट सही ढंग से इंस्टॉल किया गया है। हिंदी फोट को ठीक से देखने में कठिनाई होने पर, बोलीदाताओं को सलाह दी जाती है कि वे अपने कंप्यूटर में हिंदी भाषा का फ्रंट इंस्टॉल करें।

PART A: NIT DETAILS

1	NIT No:	VECC/MEG/ES/NIT/25-26/B-64/37 DT: 07/01/2026
2	Name of the work कार्य का नाम	Supply installation of Electrical distribution panels for SCC LCW system in VECC. वीईसीसी में एससीसी एलसीडब्ल्यू प्रणाली के लिए विद्युत वितरण पैनलों की आपूर्ति स्थापना।।
3	Estimated cost put to tender निविदा की अनुमानित लागत	₹ 19,00,000.00
4	Earnest Money Deposit (EMD) अर्नेस्ट मनी डिपाजिट (ई.एम.डी)	Amount: ₹ 38,000.00 Further details on preparation and submission of EMD has been specified in "PART B – Section 4: Submission of Bids" of this tender document. राशि: 38,000.00 भारतीय रुपया ई.एम.डी तैयार करने और जमा करने के बारे में अधिक जानकारी निविदा दस्तावेज में "भाग 'ब' - धारा 4: बोली का प्रस्तुतीकरण" में निर्दिष्ट किया गया है।
5	Completion period काम की अवधि	120 days (Refer to PART-D section 6 for further details) 120 दिन (अधिक जानकारी के लिए भाग-डी अनुभाग 6 देखें)
6	Fee of Tender Document निविदा दस्तावेज के लिए शुल्क	Nil / शून्य
7	Tender Processing Fee टेंडर प्रोसेसिंग फीस	Nil/ शून्य
8	Security Deposit सुरक्षा जमा राशि	2.5% of the tendered value निविदा मूल्य का 2.5%
9	Performance Guarantee परफॉरमेंस गुरुंटी	5% of the tendered value निविदा मूल्य का 5%
10	Date & Time of publish of tender निविदा प्रकाशित होने की तिथि एवं समय	07/01/2026 17:00 h on CPPP site https://eprocure.gov.in/eprocure/app Detailed NIT is also available on website https://www.vecc.gov.in/notifications/details/1 for view only.
11	Tender document download start date & time निविदा दस्तावेज डाउनलोड प्रारंभ तिथि और समय	07/01/2026 18:00 h
12	Tender document download end date & time निविदा दस्तावेज डाउनलोड करने की अंतिम तिथि और समय	27/01/2026 15:00 h
13	Seek clarification start date & time स्पष्टीकरण मांगने की प्रारंभ तिथि और समय	08/01/2026 09:00 h on CPPP site https://eprocure.gov.in/eprocure/app or queries may be sent to < jenamani@vecc.gov.in > , < usp@vecc.gov.in >
14	Seek clarification end date & Time स्पष्टीकरण मांगने की समाप्ति तिथि और समय	13/01/2026 15:00 h
15	Bid submission start date & time	11/01/2026 09:00 h

	बोली जमा करने की आरंभ तिथि और समय	
16	Bid submission end date & time बोली जमा करने की अंतिम तिथि और समय	27/01/2026 15:00 h
17	Date & Time of online opening of technical bid टेक्निकल बोली ऑनलाइन खोलने की तिथि एवं समय	28/01/2026 15:30 h
18	Date & time of opening of financial bid of qualified bidders योग्य बोलीदाताओं की फाइनेंसियल बोली खोलने की तिथि और समय	Will be notified at a later date

Note:

1. Department reserves the right to accept or reject the tender(s) in full or in part, without assigning any reason thereof.
2. Tenders with any condition including conditional rebate shall be rejected forthwith.
3. Tenders in which any of the prescribed conditions are not fulfilled or incomplete in any respect are liable to be rejected.

नोट:

1. विभाग के पास बिना कोई कारण बताए निविदा को पूर्ण या आंशिक रूप से स्वीकार या अस्वीकार करने का अधिकार सुरक्षित है।
2. सर्वत्र छूट सहित किसी भी शर्त वाली निविदाओं को तत्काल अस्वीकार कर दिया जाएगा।
3. जिन निविदाओं में निर्धारित शर्तों में से कोई भी पूरी नहीं होती है या किसी भी तरह से अधूरी हैं, उन्हें अस्वीकार कर दिया जाएगा।

PART B: GUIDELINES FOR E-TENDERING [Instructions for Online Bid Submission]

The bidders are required to submit soft copies of their bids electronically on the CPP Portal, using valid Digital Signature Certificates. The instructions given below are meant to assist the bidders in registering on the CPP Portal, prepare their bids in accordance with the requirements and submitting their bids online on the CPP Portal.

More information useful for submitting online bids on the CPP Portal may be obtained at:

<https://eprocure.gov.in/eprocure/app>.

1. REGISTRATION

- 1) Bidders are required to enroll on the e-Procurement module of the Central Public Procurement Portal (URL:<https://eprocure.gov.in/eprocure/app>) by clicking on the link "**Online bidder Enrollment**" on the CPP Portal which is free of charge.
- 2) As part of the enrolment process, the bidders will be required to choose a unique username and assign a password for their accounts.
- 3) Bidders are advised to register their valid email address and mobile numbers as part of the registration process. These would be used for any communication from the CPP Portal.
- 4) Upon enrolment, the bidders will be required to register their valid Digital Signature Certificate (Class III Certificates with signing key usage) issued by any Certifying Authority recognized by CCA India (e.g. Sify / nCode / eMudhra etc.), with their profile.
- 5) Only one valid DSC should be registered by a bidder. Please note that the bidders are responsible to ensure that they do not lend their DSC's to others which may lead to misuse.
- 6) Bidder can logon in to the site through the secured log-in by entering their user ID / password and the password of the DSC /e-Token.

2. SEARCHING FOR TENDER DOCUMENTS:

- 1) There are various search options built in the CPP Portal, to facilitate bidders to search active tenders by several parameters. These parameters could include Tender ID, Organization Name, Location, Date, Value, etc. There is also an option of advanced search for tenders, wherein the bidders may combine a number of search parameters such as Organization Name, Form of Contract, Location, Date, Other keywords etc. to search for a tender published on the CPP Portal.
- 2) Once the bidders have selected the tenders they are interested in, they may download the required documents / tender schedules. These tenders can be moved to the respective 'My Tenders' folder. This would enable the CPP Portal to intimate the bidders through SMS / e- mail in case there is any corrigendum issued to the tender document.
- 3) The bidder should make a note of the unique Tender ID assigned to each tender, in case they want to obtain any clarification / help from the Help desk.

3. PREPARATION OF BIDS

- 1) Bidder should take into account any corrigendum published on the tender document before submitting their bids.
- 2) Please go through the tender advertisement and the tender document carefully to understand the documents required to be submitted as part of the bid. Please note the number of covers in which the bid documents have to be submitted, the number of documents - including the names and content of each of the document that need to be submitted. Any deviations from these may lead to rejection of the bid.

- 3) Bidder, in advance, should get ready the bid documents to be submitted as indicated in the tender document / schedule and generally, they can be in PDF / XLS / RAR / DWF / JPG formats. Bid documents may be scanned with 100 dpi with black and white option which helps in reducing size of the scanned document.
- 4) To avoid the time and effort required in uploading the same set of standard documents which are required to be submitted as a part of every bid, a provision of uploading such standard documents (e.g. PAN card copy, annual reports, auditor certificates etc.) has been provided to the bidders. Bidders can use "MySpace" or "Other important Documents" area available to them to upload such documents. These documents may be directly submitted from the "My Space" area while submitting a bid, and need not be uploaded again and again. This will lead to a reduction in the time required for bid submission process.

Note: My Documents space is only a repository given to the Bidders to ease the uploading process. If Bidder has uploaded his Documents in My Documents space, this does not automatically ensure these Documents being part of Technical Bid.

4. SUBMISSION OF BIDS

- 1) Bids shall be submitted online only at CPPP website : <https://eprocure.gov.in/eprocure/app>
- 2) Bidder should log into the site well in advance for bid submission so that they can upload the bid in time i.e. on or before the bid submission time. Bidder will be responsible for any delay due to other issues.
- 3) The bidder has to digitally sign and upload the required bid documents one by one as indicated in the tender document.
- 4) Bidder has to select the payment option as "offline" to pay the tender fee / EMD as applicable and enter details of the instrument.
- 5) The EMD amount has been specified in "PART A: NIT DETAILS". The bidder should submit the total EMD amount in the form of Fixed Deposit Receipt / Demand Draft / Banker's Cheque issued by a Scheduled bank in favour of Pay & Accounts Officer, VECC, Payable at Kolkata.

Note:

- The bidder should upload the scanned copy of the EMD document in the CPP portal while submitting his bids. The original EMD should be sent well in advance to the concerned officials mentioned in "PART A: Seek clarification start date & time" of NIT so as to reach them before "Date & Time of online opening of technical bid" mentioned in PART-A of NIT, otherwise the uploaded bid will be rejected.
 - The details of the DD / any other accepted instrument, physically sent, should tally with the details available in the scanned copy and the data entered during bid submission time. Otherwise, the uploaded bid will be rejected.
 - EMD in the form of cheque will not be accepted
- 6) The bidder shall download the pre bid clarification if any for the work and upload the same (scanned copy) duly signed and sealed. The revised documents (if any) shall be uploaded in e tender portal.
 - 7) Bidders are requested to note that they should necessarily submit their financial bids in the format provided and no other format is acceptable. If the price bid has been given as a standard BoQ format with the tender document, then the same is to be downloaded and to be filled by all the bidders. Bidders are required to download the BoQ file, open it and complete the SKY BLUE coloured (unprotected) cells with their respective financial quotes and other details (such as name of the bidder). No other cells should be changed. Once the details have been completed, the bidder should save it and submit it online, without changing the filename. If the BoQ file is found to be modified by the bidder, the bid will be rejected.
 - 8) Tenderers are advised to upload their documents well in advance, to avoid last minutes rush on the server or complications in uploading. VECC, in any case, shall not be held responsible for any type of difficulties during uploading the documents including server and technical problems whatsoever.

- 9) Bid documents may be scanned with 100 dpi with black and white option which helps in reducing size of the scanned document.
- 10) The server time (which is displayed on the bidders' dashboard) will be considered as the standard time for referencing the deadlines for submission of the bids by the bidders, opening of bids etc. The bidders should follow this time during bid submission.
- 11) Submission of the tender documents after the due date and time (including extended period) shall not be permitted.
- 12) All the documents being submitted by the bidders would be encrypted using PKI encryption techniques to ensure the secrecy of the data. The data entered cannot be viewed by unauthorized persons until the time of bid opening. The confidentiality of the bids is maintained using the secured Socket Layer 128 bit encryption technology. Data storage encryption of sensitive fields is done. Any bid document that is uploaded to the server is subjected to symmetric encryption using a system generated symmetric key. Further this key is subjected to asymmetric encryption using buyers/bid opener's public keys. Overall, the uploaded tender documents become readable only after the tender opening by the authorized bid openers.
- 13) The uploaded tender documents become readable only after the tender opening by the authorized bid openers.
- 14) Upon the successful and timely submission of bids (i.e. after Clicking "Freeze Bid Submission" in the portal), the portal will give a successful bid submission message & a bid summary will be displayed with the bid no. and the date & time of submission of the bid with all other relevant details.
- 15) The bid summary has to be printed and kept as an acknowledgement of the submission of the bid. This acknowledgement may be used as an entry pass for any bid opening meetings.
- 16) Intending Bidders are advised to visit this website regularly till closing date of submission to keep themselves updated as any change/ modification in the tender will be intimated through this website only by corrigendum / addendum / amendment.

5. ASSISTANCE TO BIDDERS

- 1) Any queries relating to the tender document and the terms and conditions contained therein should be addressed to the Tender Inviting Authority for a tender or the relevant contact person indicated in the tender.
- 2) Any queries relating to the process of online bid submission or queries relating to CPP Portal in general may be directed to the 24x7 CPP Portal Helpdesk.

भाग 'ख' : ई-निविदा के लिए दिशानिर्देश [अनुदेश ऑनलाइन बोली प्रस्तुत करने हेतु]

बोलीदाताओं को वैध डिजिटल हस्ताक्षर प्रमाणपत्रों का उपयोग करते हुए, सीपीपी पोर्टल पर इलेक्ट्रॉनिक रूप से अपनी बोलियों की सॉफ्ट कॉपी प्रस्तुत करनी होगी। नीचे दिए गए निर्देश बोलीदाताओं को सीपीपी पोर्टल पर पंजीकरण करने में सहायता, आवश्यकताओं के अनुसार अपनी बोलियां तैयार करने और सीपीपी पोर्टल पर अपनी बोलियां ऑनलाइन प्रस्तुत करने के लिए हैं।

सीपीपी पोर्टल पर ऑनलाइन बोलियां प्रस्तुत करने के लिए उपयोगी अधिक जानकारी <https://eprocure.gov.in/eprocure/app> पर प्राप्त की जा सकती है :

1. पंजीकरण :

- 1) बोलीदाताओं को सीपीपी पोर्टल पर "Online bidder Enrollment" लिंक पर क्लिक करके केंद्रीय सार्वजनिक खरीद पोर्टल (URL:<https://eprocure.gov.in/eprocure/app>) के ई-प्रोक्योरमेंट मॉड्यूल, जो कि निःशुल्क है, पर नामांकन करना आवश्यक है।
- 2) नामांकन प्रक्रिया के भाग के रूप में, बोलीदाताओं को एक यूनिक उपयोगकर्ता के नाम चयन करना होगा और अपने एकाउंट के लिए एक पासवर्ड देना होगा।

- 3) बोलीदाताओं को सलाह दी जाती है कि वे पंजीकरण प्रक्रिया के भाग के रूप में अपना वैध ईमेल पता और मोबाइल नंबर दर्ज करें। इनका उपयोग सीपीपी पोर्टल से किसी भी सूचना के लिए किया जाएगा।
- 4) बोलीदाताओं को, नामांकन के बाद, अपने प्रोफाइल के साथ सीसीए इडिया (जैसे सिफी/एन.कोड/ईमुद्रा आदि) द्वारा मान्यता प्राप्त किसी भी प्रमाणन प्राधिकरण द्वारा जारी अपने वैध डिजिटल हस्ताक्षर प्रमाणपत्र (हस्ताक्षर कुंजी उपयोग के साथ तृतीय श्रेणी के प्रमाण पत्र) को पंजीकृत करना होगा।
- 5) एक बोलीदाता द्वारा केवल एक ही वैध डीएससी पंजीकृत किया जाना चाहिए। कृपया ध्यान दें कि बोलीदाता यह सुनिश्चित करने के लिए जिम्मेदार हैं कि वे अपने डीएससी को दूसरों को उधार नहीं दें, अन्यथा दुरुपयोग की संभावना हो सकती है।
- 6) बोलीदाता अपनी यूजर आईडी/पासवर्ड और डीएससी/ई-टोकन का पासवर्ड दर्ज करके सुरक्षित लॉग-इन के माध्यम से साइट पर लॉग-इन कर सकते हैं।

2. निविदा दस्तावेजों की सचिंग:

- 1) सीपीपी पोर्टल में विभिन्न सर्च विकल्प बनाए गए हैं, जिससे बोलीदाताओं को सक्रिय निविदाओं को कई पैरामीटर द्वारा सर्च करने में सुविधा हो। इन मापदंडों में निविदा की आईडी, संगठन का नाम, स्थान, तिथि, मूल्य आदि शामिल हो सकते हैं। निविदाओं के लिए एडवांस्ड सर्च का विकल्प भी है, जिसमें बोलीदाता सीपीपी पोर्टल पर प्रकाशित निविदा की सर्च के लिए कई सर्च पैरामीटर को जोड़ सकते हैं जैसे संगठन का नाम, संविदा का रूप, स्थान, सीपीपी पोर्टल पर दिनांक, अन्य की-वर्ड आदि।
- 2) एक बार जब बोलीदाता अपनी रुचि के अनुसार उन निविदाओं का चयन कर लेते हैं, तो वे आवश्यक दस्तावेज/निविदा कार्यक्रम डाउनलोड कर सकते हैं। इन निविदाओं को संबंधित 'माई टेंडर' फोल्डर में ले जाया जा सकता है। यदि निविदा दस्तावेज हेतु शुद्धिपत्र जारी किया गया है तो इससे सीपीपी पोर्टल एसएमएस/ई-मेल के माध्यम से बोलीदाताओं को सूचित करने में सक्षम होगा।
- 3) यदि बोलीदाता हेल्पडेस्क से कोई स्पष्टीकरण/सहायता प्राप्त करना चाहता है तो उसे प्रत्येक निविदा के संबंध में प्रदाव की गयी विशिष्ट निविदा आईडी को नोट करना चाहिए।

3. बोली की तैयारी:

- 1) बोलीदाता को अपनी बोली प्रस्तुत करने से पहले निविदा दस्तावेज हेतु प्रकाशित किसी भी शुद्धिपत्र को ध्यान में रखना चाहिए।
- 2) बोली के भाग के रूप में प्रस्तुत किए जाने वाले आवश्यक दस्तावेजों को समझने के लिए कृपया निविदा विज्ञापन और निविदा दस्तावेज को ध्यान से दें। कृपया उन कवरों की संख्या पर ध्यान दें जिनमें बोली दस्तावेज जमा किए जाने हैं, दस्तावेजों की संख्या - जिसमें प्रस्तुत किए जाने वाले प्रत्येक दस्तावेज के नाम और सामग्री शामिल हैं। इनमें से किसी में भी अंतर होने पर बोली को अस्वीकार किया जा सकता है।
- 3) बोलीदाता को निविदा दस्तावेज/अनुसूची के अनुसार प्रस्तुत किए जाने वाले बोली दस्तावेज को अग्रिम रूप से तैयार करने चाहिए और सामान्यतया, वे पीडीएफ/एक्सएलएस/आरएआर/डीडब्ल्यूएफ/जेपीजी प्रारूपों में हो सकते हैं। बोली दस्तावेजों को 100 डीपीआई के साथ ब्लैक एंड व्हाइट विकल्प के साथ स्कैन किया जा सकता है जो स्कैन किए गए दस्तावेज के आकार को कम करने में मदद करता है।
- 4) मानक दस्तावेजों, जिन्हें प्रत्येक बोली के एक भाग के रूप में प्रस्तुत करने की आवश्यकता होती है, के उसी सेट को अपलोड करने में आवश्यक समय और प्रयास से बचने के लिए, ऐसे मानक दस्तावेजों (जैसे पैन कार्ड की प्रति, वार्षिक रिपोर्ट, लेखा परीक्षक का प्रमाण पत्र आदि) को अपलोड करने का एक प्रावधान बोलीदाताओं को प्रदान किया गया है। बोलीदाता ऐसे दस्तावेज अपलोड करने के लिए उनके लिए उपलब्ध "माइस्पेस" या "अन्य महत्वपूर्ण दस्तावेज" थ्रेट्र का उपयोग कर सकते हैं। इन दस्तावेजों को सीधे "माईस्पेस" एप्लियो से बोली सबमिट करते समय सबमिट किया जा सकता है, और उन्हें दोबारा अपलोड करने की आवश्यकता नहीं है। इससे बोली प्रस्तुत करने की प्रक्रिया में लगाने वाले अपेक्षित समय में कमी आएगी।

नोट: *My Documents* स्पेस केवल अपलोड करने की प्रक्रिया को आसान बनाने के लिए बोलीदाताओं को दिया गया एक रिपोजिटरी है। यदि बोलीदाता ने अपने दस्तावेज *My Documents* वाले स्थान में अपलोड किए हैं, तो यह स्वचालित रूप से यह सुनिश्चित नहीं करता है कि ये दस्तावेज तकनीकी बोली का एक भाग हैं।

4. बोली का प्रस्तुतीकरण:

- 1) बोलियां केवल सीपीपीपी वेबसाइट : <https://eprocure.gov.in/eprocure/app> पर ऑनलाइन प्रस्तुत की जाएंगी।
- 2) बोलीदाता को बोली प्रस्तुत करने के लिए पहले ही साइट पर लॉग इन करना चाहिए ताकि वे समय पर अर्थात बोली प्रस्तुत करने के समय पर या उससे पहले बोली अपलोड कर सकें। किसी अन्य कारण से किसी भी देरी के लिए बोलीदाता ही जिम्मेवार होगा।

- 3) बोलीदाता को निविदा में दर्शाए गए दस्तावेज अनुसार आवश्यक बोली दस्तावेजों को एक-एक करके डिजिटल रूप से हस्ताक्षरित और अपलोड करना होगा।
- 4) बोलीदाता को निविदा शुल्क / ईएमडी का भुगतान करने के लिए "ऑफलाइन" के रूप में भुगतान विकल्प का चयन करना होगा तथा उपकरण का विवरण दर्ज करना होगा।
- 5) ई.एम.डी. राशि "पार्ट-A: एन.आई.टी. डिटेल्स" में निर्दिष्ट की गई है। बोलीदाता कुल ई.एम.डी राशि फिक्स्ड डिपाजिट रिसिप्ट / डिमांड ड्राफ्ट / बैंकर्स चेक, जो एक अनुसूचित बैंक द्वारा पे & एकाउंट्स ऑफिसर, वी.ई.सी.सी., कोलकाता में देय के पक्ष में जारी किया गया है, के रूप में जमा करना चाहिए।

नोट:

- बोलीदाता को अपनी बोलियां जमा करते समय ई.एम.डी. दस्तावेज की स्कैन कॉपी सी.पी.पी. पोर्टल पर अपलोड करनी चाहिए। असली ई.एम.डी. एन.आई.टी. के "पार्ट ए: स्पष्टीकरण मांगने की समाप्ति तिथि और समय" में उल्लिखित संबंधित अधिकारियों को अग्रिम रूप से भेजी जानी चाहिए ताकि वे भाग-ए में उल्लिखित "टेक्निकल बोली ऑनलाइन खोलने की तिथि एवं समय" से पहले पहुंच सकें। अन्यथा अपलोड की गई बोली को अस्वीकार कर दिया जाएगा।
 - भौतिक रूप से भेजी गई ई.एम.डी. का विवरण, अपलोड की गई स्कैन की गई प्रति में उपलब्ध विवरण और बोली जमा करने के समय दर्ज किए गए डेटा से मेल खाना चाहिए। अन्यथा अपलोड की गई बोली को अस्वीकार कर दिया जाएगा।
 - चेक के रूप में ई.एम.डी. को स्वीकार नहीं किया जाएगा।
- 6) एजेंसी कार्य के लिए बोली पूर्व स्पष्टीकरण, यदि कोई हो, एजेंसी डाउनलोड करेगी और उसे विधिवत हस्ताक्षरित और मुहरबंद (स्कैन की गई प्रति) अपलोड करेगी। संशोधित दस्तावेज (यदि कोई हो) ई-निविदा पोर्टल पर अपलोड किए जाएंगे।
 - 7) बोलीदाताओं से अनुरोध है कि वे नोट करें कि वे उपलब्ध कराए गए प्रारूप में ही अपनी वित्तीय बोलियां को अवश्य प्रस्तुत करें और कोई अन्य प्रारूप स्वीकार्य नहीं है। यदि मूल्य बोली को निविदा दस्तावेज के साथ मानक BoQ प्रारूप के रूप में दिया गया है, तो इसे डाउनलोड किया जाना है और सभी बोलीदाताओं द्वारा भरा जाना है। बोलीदाताओं को BoQ फ़ाइल डाउनलोड करने, इसे खोलने और अपने संबंधित वित्तीय उद्धरण और अन्य विवरण (जैसे बोली लगाने वाले का नाम) के साथ SKY BLUE रंग (असुरक्षित) सेल को पूरा करना आवश्यक है। कोई अन्य सेल नहीं बदला जाना चाहिए। एक बार विवरण पूरा हो जाने के बाद, बोलीदाता को फ़ाइल नाम बदले बिना इसे सेव करना चाहिए चाहिए और इसे ऑनलाइन प्रस्तुत करना चाहिए। यदि बोलीकर्ता द्वारा BoQ फ़ाइल को संशोधित पाया जाता है, तो बोली को अस्वीकार कर दिया जाएगा।
 - 8) निविदाकारों को सलाह दी जाती है कि वे अपने दस्तावेज बहुत पहले ही अपलोड कर दें, ताकि सर्वर पर अंतिम समय में हड्डी या अपलोड करने में आने वाली जटिलताओं से बचा जा सके। VECC, किसी भी मामले में, सर्वर और तकनीकी समस्याओं सहित दस्तावेजों को अपलोड करने के दौरान किसी भी प्रकार की कठिनाइयों के लिए जिम्मेवार नहीं होगा।
 - 9) बोली दस्तावेजों को 100 डीपी आई के साथ डलैक एंड डहाइट विकल्प के साथ स्कैन किया जाए। आकार को कम करने में मदद करता है।
 - 10) सर्वरटाइम (जो बोलीदाताओं के डेशबोर्ड पर प्रदर्शित होता है) को बोलीदाताओं द्वारा बोलियां प्रस्तुत करने, बोलियां खोलने आदि की समय सीमा को संदर्भित करने के लिए मानक समय माना जाएगा। बोलीदाताओं को बोली प्रस्तुत करने के दौरान इस समय का पालन करना चाहिए।
 - 11) नियत तारीख और समय (विस्तारित अवधि सहित) के बाद निविदा दस्तावेज प्रस्तुत करने की अनुमति नहीं होगी।
 - 12) बोलीदाताओं द्वारा प्रस्तुत किए जा रहे सभी दस्तावेजों को डेटा की गोपनीयता सुनिश्चित करने के लिए PKI एन्क्रिप्शन तकनीकों का उपयोग करके एन्क्रिप्ट किया जाएगा। दर्ज किए गए डेटा को अनधिकृत व्यक्तियों द्वारा बोली खोलने के समय तक नहीं देखा जा सकता है। बोलियों की गोपनीयता सुनिश्चित सॉकेट लेयर 128 बिट एन्क्रिप्शन तकनीक का उपयोग करके बनाए रखी जाती है। सेंसेटिव फ़ील्ड का डेटा स्टोरेज एन्क्रिप्शन किया जाता है। कोई भी बोली दस्तावेज जो सर्वर पर अपलोड किया जाता है, सिस्टम द्वारा जनरेट सिमेट्रिक की का उपयोग करके सिमेट्रिक एन्क्रिप्शन के अधीन होता है। इसके अलावा यह की (key) खरीदारों/बोली खोलने वाले की सार्वजनिक कुंजी का उपयोग करके असमित एन्क्रिप्शन के अधीन है। कुल मिलाकर, अपलोड किए गए निविदा दस्तावेज अधिकृत बोली खोलने वालों द्वारा निविदा खोलने के बाद ही पढ़ने योग्य हो जाते हैं।
 - 13) अपलोड किए गए निविदा दस्तावेज अधिकृत बोली खोलने वालों द्वारा निविदा खोलने के बाद ही पढ़ने लायक हो जाते हैं।
 - 14) बोलियों को सफलतापूर्वक और समय पर प्रस्तुत करने पर (अर्थात पोर्टल में "Freeze Bid Submission" पर क्लिक करने के बाद), पोर्टल एक सफल विड सबमिशन संदेश देगा और बोली संख्या के साथ संक्षिप्त समरी और अन्य सभी प्रासंगिक विवरणों के साथ बोली प्रस्तुत करने की तिथि एवं समय प्रदर्शित किया जाएगा।

- 15) बोली का सार प्रिंट किया जाना है और बोली प्रस्तुत करने की पावती के रूप में रखा जाना है। इस पावती का उपयोग किसी भी बोली खोलने की बैठक में एंट्री पास के रूप में किया जा सकता है।
- 16) इच्छुक बोलीदाताओं को सलाह दी जाती है कि वे स्वयं को अद्यतन रखने के लिए बोली प्रस्तुत करने की अंतिम तिथि तक नियमित रूप से इस वेबसाइट को देखते रहें क्योंकि निविदा में किसी भी परिवर्तन/संशोधन की सूचना इस वेबसाइट के माध्यम से केवल शुद्धिपत्र/परिशिष्ट/संशोधन द्वारा दी जाएगी।

5. बोलीदाताओं को सहायता

- 1) निविदा दस्तावेज और उसमें निहित नियमों और शर्तों से संबंधित किसी भी प्रश्न को निविदा के लिए निविदा आमंत्रण प्राधिकारी या निविदा में इंगित संबंधित संपर्क व्यक्ति को संबोधित किया जाना चाहिए।
- 2) ऑनलाइन बोली जमा करने की प्रक्रिया से संबंधित कोई भी प्रश्न या सामान्य रूप से सीपीपी पोर्टल से संबंधित प्रश्नों को 24x7 सीपीपी पोर्टल हेल्पडेस्क को निर्देशित किया जा सकता है।

PART C: TENDER REQUIREMENTS FOR ELIGIBILITY:

1. The details of the tender requirements for eligibility and various documents to be submitted to the vendor has been provided in the file "Informationfromvendor.xls".
2. The excel file has multiple sheets e.g. (a) Information sheet (b) Instruction sheet (c) Tender Acceptance Letter (d) Undertaking. The bidders should carefully go through all the sheets of the excel file.
3. Bidders are required to download the file "Informationfromvendor.xls", open it and complete the SKY BLUE coloured (unprotected) cells in the "information sheet" with their respective details. No other cells should be changed. Bidders are advised to read and follow the "Instruction sheet" of the excel file before filling up the "information sheet". Once the details have been filled up, the bidder should upload the "pdf" version of the "information sheet" along with other certificates and declarations mentioned in the excel file under the heading "PART IV: Certificates – all are mandatory" as a single pdf file.
4. Bidders are required to fill up the two forms as per the format given in the sheets (a) Tender Acceptance Letter (b) Undertaking of the excel file "Informationfromvendor.xls" on their letterhead and upload the scanned copy of the same in the CPPP portal along with other requisite documents.
5. It is bidder's responsibility to provide the correct information in the excel file and to upload the scanned copies of the correct files in the CPP portal where ever applicable.
6. The e-mail i/d and/ or telephone/ mobile numbers provided by the vendor should remain active during the entire tender evaluation process as these information may be used for communicating with the vendor, if necessary.

भाग ग: पात्रता के लिए निविदा आवश्यकताएँ:

1. पात्रता के लिए निविदा आवश्यकताओं और बैंडर को प्रस्तुत किए जाने वाले विभिन्न दस्तावेजों का विवरण "Informationfromvendor.xls" फ़ाइल में उपलब्ध कराया गया है।
2. एक्सेल फाइल में कई शीट हैं यथा, (a) Information sheet (b) Instruction sheet (c) Tender Acceptance Letter (d) Undertaking। बोलीदाताओं को एक्सेल फाइल की सभी शीटों को ध्यान से देखना चाहिए।
3. बोलीदाताओं "Informationfromvendor.xls" फाइल डाउनलोड करें, इसे खोलें और अपने संबंधित विवरण के साथ "सूचना पत्रक" में SKY BLUE रंग (अनप्रोटेक्टेड) सेल को भरें। कोई अन्य सेल नहीं बदला जाना चाहिए। बोलीदाताओं को सलाह दी जाती है कि वे "information sheet" भरने से पहले एक्सेल फाइल के "instruction sheet" को पढ़ें और उनका अनुपालन करें। एक बार विवरण भरने के बाद, बोलीदाता को "PART IV: Certificates – all are mandatory" शीर्षक के तहत एक्सेल फाइल में उल्लिखित अन्य प्रमाणपत्रों और घोषणाओं के साथ "information sheet" का "pdf" संस्करण एक एकल पीडीएफ दस्तावेज के रूप में अपलोड करना चाहिए।

4. बोलीदाताओं को एक्सेल फाइल "Informationfromvendor.xls" की दो शीट ("Tender acceptance letter", "Undertaking") में दिए गए प्रारूप के अनुसार उनके लेटरहेड पर दो फॉर्म भरने की आवश्यकता होती है और अन्य आवश्यक दस्तावेजों के साथ उसी की स्कैन की हुई कॉपी सीपीपीपी पोर्टल पर अपलोड करें।
5. एक्सेल फाइल में सही जानकारी प्रदान करना और सीपीपी पोर्टल में सही फाइलों की स्कैन की गई प्रतियों को जहां कहीं लागू हो, अपलोड करना बोलीदाता की ही जिम्मेदारी है।
6. वेंडर द्वारा प्रदान किया गया ई-मेल आई/डी और/या टेलीफोन/मोबाइल नंबर निविदा की पूरी मूल्यांकन प्रक्रिया के दौरान सक्रिय रहना चाहिए क्योंकि यदि आवश्यक हो तो इन सूचनाओं का उपयोग विक्रेता के साथ संवाद करने के लिए किया जा सकता है।

PART D: GENERAL CONDITIONS OF CONTRACT:

1. **Tender Rates:**
 - a. The bidders shall quote their rates in the excel file of the price bid uploaded in the CPP portal only. Refer to "PART B" of this document for further information.
 - b. The quoted rate should be inclusive of all costs e.g. basic rate, central as well as State Government taxes & levies, packing & transportation costs, including profit. Also refer to PART-D and PART-E of this document for detailed information.
2. **Performance Gurantee:**
 - a. The tenderer whose tender is accepted, will be required to deposit Performance Guarantee @ 5% of tendered value within 15 days from the date of receipt of the work order. Performance Guarantee can be submitted in the form of PBG (Performance Bank Guarantee), FDR (Fixed Deposit Receipt), DD (Demand Draft), BC (Banker's Cheque) etc. issued by any Schedules bank drawn in favour of **Pay & Accounts Officer, VECC, payable at Kolkata**. This period can be further extended by the Engineer-in-charge on written request of the contractor stating the reason for delays in submitting the Performance Guarantee, to the satisfaction of the Engineer-in-charge. Late fee (@ 0.1% per day of PBG amount) will be levied for the delayed submission of PBG.
 - b. The Performance Guarantee shall be initially valid up to the stipulated date of completion plus 60 days beyond that. In case the time for completion of work gets enlarged, the contractor shall get the validity of Performance Guarantee extended to cover such enlarged time for completion of work.
 - c. After recording of the completion certificate for the work by the competent authority, the performance guarantee shall be returned to the contractor, without any interest.
3. **Security Deposit:**
 - a. Security Deposit @ 2.5% of tendered value as worked out on the basis of tendered cost will be recovered @ 2.5% of the gross value of each bill including final bill.
 - b. Defect Liability Period (DLP) for work order value below 10 Lakhs is 6 months and above 10 Lakhs is 12 months. The Security Deposit will be returned after DLP of the job or passing of final bill whichever is later.
 - c. No interest will be paid to the security deposit (SD).
4. **Contractor's responsibility towards his employees:**
 - a. The employees engaged by the contractor for this work will be in the pay roll of the contractor only and VECC will not be held responsible in any way.
 - b. The Contract shall comply with all Central, State and Municipal laws and rules and shall be solely responsible for complying with the provisions of the Contract Labour (Regulation and Abolition) Act, 1970, and the rules there under and the other enactments that may be applicable including the Payment of Wages Act, 1936, Factory Act 1948, Workmen's Compensation Act, 1923 or any other applicable legislation and Municipal Bye-laws or other Statutory rules and regulations, whatsoever, in force. In so far as these are applicable, any obligations, financial or otherwise, imposed under any statutory enactments, rules and regulations, there under shall be the sole responsibility of the contractor.

5. Payment of Bills:

- a. Payment will be made by Pay & Accounts Officer, VECC.
- b. Payment will be made through RTGS/NEFT mode only.
- c. The payment is subject to TDS applicable under Income Tax Act, 1961. As per instructions of Ministry of Finance, a recovery of Income Tax @ 2% of gross value of work done, will be made from all the bills in respect of this work and the amount so recovered will be credited to the Income Tax Authorities and a certificate for the amount so credited will be issued by the **Pay & Accounts Officer, VECC, Kolkata.**
- d. TDS @ 2% or as applicable U/S 51 of GST Act. 2017 will also be recovered from the bills and TDS thereof will be uploaded in GST portal by **Pay & Accounts Officer, VECC, Kolkata.** Any other taxes as per Government directives shall be deducted from each bill paid to the contractor, from time to time.

6. Security & Safety Regulations:

- a. All the requirements mentioned in this section are applicable during the execution of work inside any area within the jurisdiction of VECC.
- b. Safety Regulation of VECC should be strictly followed. Engineer in-charge of the work should get a work permit from industrial safety officer before commencement of work and hand it over to the representative of the vendor explaining all the safety regulations to be followed.
- c. Insurance coverage protecting the agency against all claims applicable under the Workmen's Compensation Act, 1948 shall be taken by the vendor. The vendor shall arrange necessary Insurance coverage for any persons deployed by him even for short duration. This Office (VECC) shall not entertain any claim arising out of mishap, if any, that may take place while discharging the duties by the personnel employed by the vendor. In the event of any liability claim falling on this office, the same shall be reimbursed by the vendor.
- d. All the persons engaged in the present contract should have valid identity proof / residence proof issued by the Government of India and should submit attested copies of documents in support of above to the security section of VECC. However due to security reasons, Security Section of VECC may ask for specific identity proof / residence proof / certification by local police as may be required.
- e. All the persons deployed in the present contract shall be liable for physical check and checking of their bags and baggage both at the time of entry and exit by the security staff as per Department security regulation. The personnel are required to be in possession of individual identity card, passes, tokens issued by VECC security.
- f. Contractor should authorise one person as vendor's supervisor to be present at the work site during execution of the job. He is required to have a valid Police Verification Certificate (PVC). The supervisor will be responsible for the following:
 - i. To receive the token for the workmen from the Security Section at the main gate of VECC to enable workmen for entry to campus.
 - ii. To communicate with Engineer-in-charge for the respective work, Security Section as and when required in connection with the work or security reasons. The above person is to submit the details of identity proof and address proof including details of himself to the DCSO, VECC before the commencement of work.

7. Deployment of personnel: (Applicable for the part of work to be conducted within VECC Premises)

- a. Personnel employed for the job shall be in proper attire. The entire crew shall work under overall supervision of the Supervisor of the contractor or, his Authorized staff.
- b. The Engineer in Charge may ask the contractor to dismiss or remove any person or persons, who may be incompetent or misconduct himself or has been charged with having committed criminal action or negligent in the proper performance of his duties. All such persons shall not again be employed in executing the job within the scope of the present contract.
- c. The vendor shall be responsible for any loss/ damage of property or equipment etc. by their employees.

8. Contact details related to this tender:

- a. Different officers of this Department as well as CPPP will be help you to solve different types of issues / problems. Contact the relevant officer ONLY, as given in the following table, based on the nature of the issue /problem.

1	For technical clarifications related to the tender	Please refer to part -A, NIT Details, 'Seek clarification start date'
2	For any help on CPP portal, trouble with tender uploading	Use the website: https://eprocure.gov.in/eprocure/app On the top right corner click "contact us" to find the 24x7 phone support and mail support
3	For vigilance related issues	Contact Vigilance Officer: Dr. Anjan Dutta Gupta, Scientific Officer (H), VECC, 1/AF Bidhannagar, Kolkata – 700 064. Tel. No. 033 2318 3206 (O) e-mail: vigilanceofficer@vecc.gov.in

भाग घ : संविदा की सामान्य शर्तें:

1. निविदा दरें:

- बोलीदाता अपनी प्रस्तावित कीमत केवल सी.पी.पी. पोर्टल में अपलोड की गई 'प्राइस बिड' की एक्सेल फाइल में उद्धृत करेंगे। अधिक जानकारी के लिए इस दस्तावेज़ का "भाग बी" देखें।
- प्रस्तावित कीमत सभी लागतों सहित होनी चाहिए, उदाहरण के लिए, मूल दर, केंद्र और साथ ही राज्य सरकार के कर और लेवी, पैकेजिंग और परिवहन लागत, लाभ इत्यादि। विस्तृत जानकारी के लिए इस दस्तावेज़ का भाग-डी और भाग-ई भी देखें।

2. कार्यनिष्पादन गारंटी:

- जिस निविदाकार की निविदा स्वीकार की जाती है, उसे कार्यदिश प्राप्त होने की तिथि से 15 दिनों के भीतर निविदा मूल्य का 5% कार्यनिष्पादन गारंटी प्रस्तुत करनी होगी। निष्पादन गारंटी भुगतान एवं लेखा अधिकारी, वीईसीसी, के पक्ष में आहरित, कोलकाता में देय, किसी भी अनुसूचित बैंक द्वारा जारी पीबीजी (परफोर्मेंस बैंक गारंटी), एफडीआर (सावधि जमा रसीद), डीडी (डिमांड ड्राफ्ट), बीसी (बैंकर्स चेक) आदि के रूप में प्रस्तुत की जा सकती है। इस अवधि को प्रभारी अभियंता द्वारा संविदाकर के लिखित अनुरोध पर कार्यनिष्पादन गारंटी जमा करने में देरी का कारण बताते हुए, प्रभारी अभियंता की संतुष्टि पर, आगे बढ़ाया जा सकता है। चिलंब शुल्क (पीबीजी राशि का 0.1% प्रति दिन) पीबीजी जमा करने में देरी के लिए लगाया जाएगा।
- कार्यनिष्पादन गारंटी प्रारंभ में पूर्ण होने की निर्धारित तिथि और उसके बाद 60 दिनों तक वैध होगी। यदि कार्य पूरा करने का समय बढ़ जाता है, तो संविदाकार को कार्य पूरा करने के लिए ऐसे बढ़े हुए समय को कवर करने के लिए निष्पादन गारंटी की वैधता बढ़ानी होगी।
- सक्षम प्राधिकारी द्वारा कार्य के लिए पूर्णता प्रमाण पत्र की रिकॉर्डिंग के बाद, कार्यनिष्पादन गारंटी संविदाकार को बिना किसी ब्याज के वापस कर दी जाएगी।

3. सुरक्षा जमा:

- सुरक्षा जमा @ निविदा मूल्य का 2.5% जैसा कि निविदा लागत के आधार पर निकाला गया है, अंतिम बिल सहित प्रत्येक बिल के सकल मूल्य के 2.5% की दर से वसूल किया जाएगा।

- b. 10 लाख से कम कार्यादिश मूल्य के लिए “डिफेक्ट लायबिलिटी पीरियड” 6 महीने के लिए है और 10 लाख से अधिक कार्यादिश मूल्य के लिए “डिफेक्ट लायबिलिटी पीरियड” 12 महीने है। सुरक्षा जमा, “डिफेक्ट लायबिलिटी पीरियड” पूरा होने के बाद या अंतिम विल पारित होने के बाद, जो भी बाद में हो, वापस कर दिया जाएगा।
- c. सुरक्षा जमा (एस डी) पर कोई ब्याज नहीं दिया जाएगा।

4. अपने कर्मचारियों के प्रति ठेकेदार की जिम्मेदारी:

- a. संविदाकार द्वारा कार्य में लगाए गए कर्मचारी केवल संविदाकार के पे रोल में होंगे और वीईसीसी इसका किसी भी तरह से जिम्मेदार नहीं होगा।
- b. यह संविदा सभी केंद्रीय, राज्य और नगरपालिका कानूनों और नियमों का अनुपालन करेगा और संविदा श्रम (विनियमन और उन्मूलन) अधिनियम, 1970 के प्रावधानों और उसके तहत नियमों और अन्य अधिनियमों, जो लागू हो, के अनुपालन के लिए पूरी तरह से जिम्मेदार होगा। मजदूरी भुगतान अधिनियम, 1936, कारखाना अधिनियम 1948, कामगार मुआवजा अधिनियम, 1923 या कोई अन्य लागू कानून और नगरपालिका उप-नियम या अन्य वैधानिक नियम और विनियम, जो भी लागू हों, शामिल हैं। जहां तक ये लागू हैं, किसी भी संवैधानिक अधिनियमों, नियमों और विनियमों के तहत लगाए गए किसी भी दायित्व, वित्तीय या अन्यथा, एकमात्र जिम्मेदारी या संविदाकार की होगी।

5. बिलों का भुगतान:

- a. भुगतान वेतन एवं लेखा अधिकारी, वीईसीसी, द्वारा किया जाएगा।
- b. भुगतान केवल आर.टी.जी.एस / एन.ई.एफ.टी मोड के माध्यम से किया जाएगा।
- c. भुगतान आयकर अधिनियम, 1961 के तहत लागू टीडीएस के अधीन है। वित्त मंत्रालय के अनुदेशों के अनुसार, किए गए कार्य के सकल मूल्य के 2% की दर से आयकर की वसूली इस कार्य के संबंध में सभी बिलों से की जाएगी और इस प्रकार वसूल की गई राशि आयकर अधिकारियों को जमा की जाएगी और एक इस प्रकार जमा की गई राशि का प्रमाण पत्र भुगतान एवं लेखा अधिकारी, वीईसीसी, कोलकाता द्वारा जारी किया जाएगा।
- d. टीडीएस @ 2% या जीएसटी अधिनियम 2017 के अधीन लागू U/S 51 के रूप में, को भी बिलों से वसूल किया जाएगा और उसके टीडीएस को भुगतान एवं लेखा अधिकारी, वीईसीसी, कोलकाता द्वारा जीएसटी पोर्टल पर अपलोड किया जाएगा। सरकार के निदेशों के अनुसार कोई अन्य कर, समय-समय पर, भुगतान किए गए प्रत्येक बिल से काट लिया जाएगा।

6. सुरक्षा एवं संरक्षा विनियम :

- a. इस खंड में उल्लिखित सभी आवश्यकताएं वी.ई.सी.सी. के अधिकार क्षेत्र के भीतर किसी भी क्षेत्र के अंदर कार्य के निष्पादन के दौरान लागू होती हैं।
- b. कार्य की पूरी अवधि के दौरान वी.ई.सी.सी. की सुरक्षा दिशानिर्देश का कड़ाई से पालन होना चाहिए। कार्य के ‘इंजीनियर इन चार्ज’ को ‘इंडस्ट्रियल सेफटी अफसर’ से ‘वर्क परमिट’ प्राप्त करना चाहिए और इसे विक्रेता के प्रतिनिधि को पालन किए जाने वाले सभी सुरक्षा नियमों की व्याख्या करने के बाद सौंपना चाहिए।
- c. ‘वर्कमेन’स कंपनसेशन एक्ट - 1948’ अधिनियम के तहत लागू सभी दावों के खिलाफ एजेंसी की रक्षा करने वाला बीमा कवरेज विक्रेता द्वारा लिया जाएगा। विक्रेता को अपने द्वारा तैनात किसी भी व्यक्ति के लिए (कम अवधि के लिए भी) आवश्यक बीमा कवरेज की व्यवस्था करनी चाहिए। यदि विक्रेता द्वारा नियोजित कर्मियों द्वारा कर्तव्यों का निर्वहन करते समय कोई दुर्घटना होती है, तो यह कार्यालय (वी.ई.सी.सी.) इससे उत्पन्न होने वाले किसी भी दावे पर विचार नहीं करेगा। इस कार्यालय पर किसी भी दायित्व के दावे के आने की स्थिति में, उसकी प्रतिपूर्ति विक्रेता द्वारा की जानी चाहिए।
- d. वर्तमान संविदा में लगे प्रत्येक व्यक्ति के पास वैध पहचान पत्र/आवासीय प्रमाण होने चाहिए और उपर्युक्त के समर्थन में उन्हें दस्तावेजों की ‘अटेंडेड कपीस’ वी.ई.सी.सी. के सुरक्षा अनुभाग में जमा करनी चाहिए। हलांकि सुरक्षा कारणों के

- कारण वी.ई.सी.सी. का सुरक्षा अनुभाग आवश्यकतानुसार विशिष्ट पहचान पत्र/आवासीय प्रमाण/स्थानीय पुलिस द्वारा प्रशासन हेतु पूछ सकते हैं।
- e. विभागीय सुरक्षा नियमन के अनुसार वर्तमान अनुबंध में तैनात सभी व्यक्ति और उनके बैग और बैगेज की उनकी प्रविष्टि और निकासी के दौरान सुरक्षा स्टाफ द्वारा जांच की जाएगी। कार्मिकों के पास वैयक्तिक पहचान पत्र अथवा पास होने चाहिए।
 - f. ठेकेदार को कार्य के निष्पादन के दौरान एक व्यक्ति को पर्यवेक्षक के रूप में कार्य स्थल पर उपस्थित होने के लिए अधिकृत करना चाहिए। उसके पास एक बैध 'पुलिस वेरिफिकेशन सर्टिफिकेट' होना आवश्यक है। पर्यवेक्षक निम्नलिखित कार्यों के लिए जिम्मेदार होंगे :
 - i. वी.ई.सी.सी. के मुख्य द्वार पर सुरक्षा अनुभाग से कर्मचारियों के कार्यालय परिसर के अंदर प्रवेश के लिए टोकन प्राप्त करना।
 - ii. कार्य से संबंधित 'इंजीनियर इन चार्ज' से विचार - विमर्श तथा आवश्यकता पड़ने पर सुरक्षा अनुभाग के साथ चर्चा करने के लिए। 'पर्यवेक्षक' को काम शुरू करने से पहले वी.ई.सी.सी. के सुरक्षा अनुभाग में अपने पहचान प्रमाण, पते के प्रमाण और बैध 'पुलिस वेरिफिकेशन सर्टिफिकेट' का विवरण प्रस्तुत करना होगा।

7. कर्मियों की तैनाती: (VECC परिसर के अंदर निष्पादित किए जाने वाले कार्य के भाग के लिए लागू)

- a. कार्य के लिए तैनात कार्मिक उचित पोशाक में होने चाहिए। समस्त कार्मिक ठेकेदार के सुपरवाइजर या उसके अधिकृत कर्मचारियों के समग्र पर्यवेक्षण में कार्य करेंगे।
- b. वी.प्रभारी अभियंता को उस व्यक्ति या व्यक्तियों को हटाने हेतु परामर्शदाता की आवश्यकता हो सकती है जो अयोग्य है अथवा दुराचार करता हो अथवा जिस पर आपराधिक कार्य हेतु करने का आरोप लगा हो अथवा अपने कार्यों को ठीक तरह से करने में लापरवाह हो। ऐसे व्यक्ति को वर्तमान संविदा के कार्यक्षेत्र में कार्य निष्पादन करने हेतु पुनः नहीं लिया जाएगा।
- c. विक्रेता वी.ई.सी.सी. की संपत्ति, उपकरण आदि के किसी भी नुकसान/क्षति के लिए अपने कर्मचारियों के लिए जिम्मेदार होगा।

8. इस निविदा से जुड़े संपर्क विवरण :-

- ए. इस विभाग के अलग-अलग अधिकारी तथा सीपीपीपी अलग-अलग प्रकार के मुद्रे/समस्याओं को हल करने में आपकी मदद करेंगे।

निम्नलिखित तालिका में दिए गए केवल संबंधित अधिकारी को मुद्रा/समस्या के अनुसार ही संपर्क करें।

1	निविदा संबंधी तकनीकी स्पष्टीकरण हेतु	कृपया भाग-क का संदर्भ लें, 'निविदा विवरण स्पष्टीकरण' आरंभ करने की तारीख को देखें
2	सीपीपीपी पोर्टल पर, निविदा अपलोड करने में समस्या होने पर, किसी प्रकार की सहायता हेतु	वेबसाइट का प्रयोग करें http://eprocure.gov.in/eprocure/app उपर के दाहिने कोने पर 'कॉटैक्ट' को क्लिक करें ताकि 24 X 7 कॉल और मेल की सहायता मिले।
3	सतर्कता संबंधी मामलों के लिए	सतर्कता अधिकारी को संपर्क करें डॉ. अर्जन दत्ता गुप्ता, वैज्ञानिक अधिकारी (एच), वीईसीसी, 1/ए.एफ, विधान नगर, कोलकाता-700064 टेलीफोन नं. -033-2318-3206 (कार्या.) ई-मेल : vigilanceofficer@vecc.gov.in

Note:

In addition to this tender document and other documents uploaded in the CPP portal in connection to this tender, the intending bidder must read the terms and conditions as per "SECTION-1 : NOTICE INVITING TENDERS" OF "**CONDITIONS AND**

CLAUSES OF CONTRACT – 2008” carefully. He/She should only submit his/her bid if he/she consider himself/herself eligible and he/she is in possession of all the documents required.

नोट:

इस निविदा के संबंध में सीपीपी पोर्टल में अपलोड किए गए इस निविदा दस्तावेज और अन्य दस्तावेजों के अलावा, “**CLAUSES OF CONTRACT – 2008**” दस्तावेज दस्तावेजों के साथ उपलब्ध होना चाहिए।

PART E: SPECIAL CONDITIONS & SPECIFICATIONS RELATED TO THIS CONTRACT.**A. TECHNICAL SPECIFICATION****1. SCC LCW Cooling Tower Panel****Technical Parameters of Panels**

Design, manufacture, testing at manufacturer works, supply at the platform for the place of installation in the ground floor and installation, testing and commissioning at site of electrical panel. It shall be fabricated with double enclosure type of MS CRCA sheet of 2 mm thick for load bearing panel wall and 1.6 mm thick for non-load bearing panel wall, cubicle, totally enclosed, dust and vermin proof with IP 65/or higher protection with hinged and lockable doors with closed type panel keys. The panel shall be suitable for 415 volts, 400 A, 50 KA (1 Sec), 3 phase & neutral 50 Hz system. All live accessible parts shall be shrouded and all equipment shall be finger touch proof. DMC shrouds and bus bar supports shall be used.

SCC LCW Cooling Tower panel

Sl. No.	Feeder	Rating	Details.	Qty.
1.	Incomer	400A MCCB	400A, TP with Neutral Link, 50kA (Ics= 100% Icu), Thermal Magnetic Release, extended Rotary handle, spreader terminals. Meters: One number Multifunction meter for display of all electrical parameters reading is required in the front fascia. Separate indicating lamps for R, Y, B, ON, OFF, Trip required in the front door.	01 Set
2.	Outgoing	200 A, MCCB, with Star-Delta Starter for 45 kW Motor(IE-2).	200A, MCCB having 3P, 36kA (Ics= 100% Icu), Thermal Magnetic release, extended Rotary handle, spreader terminals & neutral link with ON & OFF LED indication. Automatic (with Electronic timer) Star-Delta starter for 45kW induction motor used for Pump load.	3Sets
3.	Outgoing	100A MCCB with Star-Delta Starter for 15 kW Motor(IE-2).	100A, MCCB having 3P, 36 kA (Ics= 100% Icu), Thermal Magnetic release, extended Rotary handle, spreader terminals & neutral link with ON & OFF LED indication. Automatic (with Electronic timer) Star-Delta starter for 15kW induction motor used for Pump load.	3 sets
4.	Outgoing	100Amp. MCCB	100A MCCB, 3P, 36kA (Ics=100% Icu), Thermal Magnetic release, extended Rotary handle, spreader terminals & neutral link with “ON & OFF” LED indication.	01 set
5.	Outgoing	MCB, TPN	16A MCB, TPN, 10kA, C-type.	01No.
6.	Outgoing	MCB, SP	10A MCB, SP, 10kA, C-type	03No.
<p><i>Note:</i> a) Type: Outdoor application (Double Door with double enclosure type). b) Space Available (Max): 2700mm (L) x 700 mm (D) x 2300mm(H) including base channel. c) Mounted on foot pillar.</p>				

2. SCC 600KVA UPS Power Distribution Panel:

Technical Parameters of Panels

Design, Manufacture, testing at manufacturer works, supply at the platform for the place of installation in the ground floor and installation, testing and commissioning at site of electrical panel. It shall be fabricated MS CRCA sheet of 2 mm thick for load bearing panel wall and 1.6 mm thick for non-load bearing panel wall, cubicle, extensible type, totally enclosed, dust and vermin proof with IP 65 protection with hinged and lockable doors with closed type panel keys. The panel shall be suitable for 415 volts, 1000 A, 50 kA (1 Sec), 3 phase & neutral 50 Hz system. All live accessible parts shall be shrouded and all equipment shall be finger touch proof. DMC shrouds and bus bar supports shall be used.

SCC 600KVA UPS Power Distribution Panel

Sl. No.	Feeder	Load / Rating	Details.	Qty.
1.	Incomer:	1000A MCCB	1000A, 3Pole with Neutral link, 50KA (Ics= 100% Icu), Thermal Magnetic Release, extended Rotary handle, spreader terminals. Meters: One number Multifunction meter for display of all electrical parameters reading is required in the front fascia. Separate indicating lamps for R, Y, B, ON, OFF, Trip required in the front fascia.	01 Set
2.	Out Going Feeder	630Amp, MCCB 132 KW Motor(IE-2)	630 A, MCCB having 3P, 36kA (Ics= 100% Icu), Thermal Magnetic release, extended Rotary handle, spreader terminals & neutral link with ON & OFF LED indication.	01 No.
3.	Out Going Feeder	400Amp, MCCB, Star-Delta starter for 75 kW Motor(IE-2)	400A, MCCB having 3P, 36KA (Ics= 100% Icu), Thermal Magnetic release, extended Rotary handle, spreader terminals & neutral link with ON & OFF LED indication. Star-Delta starter suitable for 75kW induction motor used for Pump load.	02 Nos.
4.	Out Going Feeder	100Amp, MCCB, Star-Delta Starter for 15 KW Motor(IE-2)	100A, MCCB having 3P, 36 kA (Ics= 100% Icu), Thermal Magnetic release, extended Rotary handle, spreader terminals & neutral link with ON & OFF LED indication. Star-Delta starter of suitable for 15kW induction motor used for Pump load.	02 Nos.
5.	Out Going Feeder	400Amp, MCCB	400A, 3P with Neutral link, 36KA (Ics= 100% Icu), Thermal magnetic release, extended rotary handle, spreader terminals. Separate indicating lamps for R, Y and B required in the front panel.	01 No.
6.	Out Going Feeder	160Amp, MCCB	160A, 3P with Neutral link, 36KA (Ics= 100% Icu), Thermal magnetic release, extended rotary handle, spreader terminals. Separate indicating lamps for R, Y and B required in the front panel.	05 No.
7.	Out Going Feeder	63Amp, MCCB	63 A, 3P with Neutral link, 36KA (Ics= 100% Icu), Thermal Magnetic Release, extended Rotary handle, spreader terminals. Separate indicating lamps for R, Y and B required in the front panel.	01No.
8.	Out Going Feeder	32Amp. TPN MCB	C curve, 10kA	05 No.

9.	Out Going Feeder	10Amp, SP MCB, for LCW Instrumentation on Power Supply.	C curve, 10kA	03 Nos.
<p><i>Note:</i> a) Panel for indoor application. b) Space Available (Max): 2700mm (L) x 600 mm (D) x 2200mm(H) including base channel. c) Floor Mounting type.</p>				

3. SCC 600KVA UPS Incomer Power Panel:

Design, Manufacture and supply at ground floor and installation of Distribution panel, fabricated from MS CRCA sheet of 2 mm thick for load bearing panel wall and 1.6 mm thick for non-load bearing panel wall, cubicle, totally enclosed, dust and vermin proof with IP 42 protection with hinged and lockable doors with closed type panel keys. The panel shall be suitable for 415 volts, 1250 A, 50 KA (1 Sec), 3 phase & neutral 50 Hz system. All live accessible parts shall be shrouded and all equipment shall be finger touch proof. DMC shrouds and bus bar supports shall be used.

Sl. No.	Feeder	Load / Rating	Details.	Qty.
1.	Incomer:	1250A MCCB	1250A, 3Pole with Neutral link, 50KA (Ics= 100% Icu), Thermal Magnetic release, extended rotary handle, spreader terminals. Meters: One number Multifunction meter for display of all electrical parameters reading is required in the front fascia. Separate indicating lamps for R, Y, B, ON, OFF, Trip required in the front fascia.	01 Set

Note: a) Panel for indoor application.
b) Space Available (Max): 650mm (L) x 400 mm (D) x 1500mm (H) including base channel.
c) Floor Mounting type.
d) Suitable Copper Bus-bars (minimum 800 sq.mm cross section) should be provided for connection between MCCBs. Suitable Bus bar arrangement should be made for termination of 04 Runs 3.5C, 240 Sq. mm Aluminum conductor, PVC insulated, GI armored cable in one side (bottom) as incomer and 04 Runs of 240 sq mm Copper Flexible for individual phases in top side of the panel.

4. General Notes for all panels:

- a) Attached Single Line Diagram may be followed for individual panels.
- b) Door opening facility: Front & back side opening.
- c) Cable Entry from bottom only.
- d) Aluminum Bus-Bar considering 0.8 A/sqmm.
- e) Gland plate thickness shall be of 3 mm.
- f) Finished painting shall be done with powder coating of Siemens grey colour. Necessary touch up paint may be done at site, if required.
- g) Control wiring including CT connections shall be done with 1.1 KV 2.5 Sq. mm 1C PVC FRLS insulated copper flexible cable. CT Shorting link with terminal should be provided and neatly bunched separately and adequately supported so as to prevent sagging and strain on termination.
- h) Incomer terminal arrangement for termination of suitable rated Al armored XLPE cable.
- i) GI earth bus shall be provided and supported at suitable interval. Connection to each earthing terminal shall be provided from the GI earth bus bar.
- j) All drawings like General arrangement, fabrication, control & power wiring along with bill materials shall be approved from the Department before fabrication of the panel.

- k) Feeder and board levels shall be of anodized Aluminium with engraved letters. All components both inside and outside of the panel shall be properly marked.
- l) Aluminum bus bars shall be provided with insulated heat shrinkable coloured (Red, Yellow, Blue & Black) sleeve.
- m) R, Y, B phase Indicating lamps shall be of LED Type (leakage light proof) with MCB.
- n) All concealed hinged doors and covers shall be provided with suitable flexible earthing connections. Closed type panel locking keys shall be provided in the panel.
- o) All non-current carrying metallic parts of the equipment shall be earthed with copper flexible wire/strip of adequate size. All neutrals shall be Isolatable type.
- p) Unloading of the panels at site is under supplier's scope. Panels shall be unloaded & delivered at ground floor. Panel shall be fabricated in such a way that; it can be unloaded & delivered at the desired location of the site.
- q) Disconnection of existing cables and reconnection of disconnected cable/wires with suitable lugs/sockets and glands (if required) will be included in the bidders' scope.
- r) Any feeder more than equal to 63 amps. Should have suitable busbar connection in both input and output of that switch.

5. Acceptance criteria for all panels:

A. Following tests will be carried out at factory.

- a) High voltage and insulation resistance testing.
- b) ON & OFF testing of incoming & outgoing feeders.
- c) ON & OFF testing of control circuit.
- d) Dimension check of the panel.
- e) Checking of bill of material with technical specification.

B. Following tests will be carried out at site.

- a) Testing of insulation resistance.
- b) Checking for any physical damage.
- c) ON/OFF testing of incomer & outgoing feeders.
- d) ON & OFF testing of control circuit.

5.1 Motor Rating:

Motor Power	: 75 kW/45kW/15kW
Rated Voltage	: 415 V
Rated Current	: 130A/88A/27A
Rated Frequency	: 50 Hz
Motor Type	: Squirrel cage induction motor
Motor Duty Cycle	: S1

5.2 Specification of Star-Delta Starter:

A. Star Delta Starter for 75kW Motor:

- i) **Contactor** : Current rating for Star- 80A 3P 415V AC -3, 50Hz
: Current rating for Delta and Main- 250A 3P 415V AC -3, 50Hz
: Coils Voltage of all Power contactors should have 415 Volt.
- ii) Over load Relay : Range 60-100
- iii) Single Phasing Preventer(SPP) : Current Sensing type SPP.
- iv) Timer : Electronic timer Star-Delta type.

B. Star Delta Starter for 45kW Motor:

- i) **Contactor** : Current rating for Star- 70A 3P 415V AC -3, 50Hz
: Current rating for Delta and Main- 95A 3P 415V AC -3, 50Hz
: Coils Voltage of all Power contactors should have 415 Volt.
- ii) Over load Relay : Range 40-70
- iii) Single Phasing Preventer(SPP) : Current Sensing type SPP.

iv) Timer : Electronic timer Star-Delta type.

C. Star Delta Starter for 15kW Motor:

- | | |
|------------------------------------|---|
| i) Contactor | : Current rating for Star- 25A 3P 415V AC -3, 50Hz |
| | : Current rating for Delta and Main- 45A 3P 415V AC -3, 50Hz |
| | : Coils Voltage of all Power contactors should have 415 Volt. |
| ii) Over load Relay | : Range 14-23 |
| iii) Single Phasing Preventer(SPP) | : Current Sensing type SPP. |
| iv) Timer | : Electronic timer Star-Delta type. |


Note: 3phase digital Ammeter in front cubicle should be installed in every starter. Local/Remote start/stop facility with leak proof LED indicating lamps for Local/Remote and ON/OFF/Trip should be provided. Suitable terminals for interlocks to be provided in the starter.


5.3 Environmental Conditions:

Ambient Temperature : 5°C to +45°C

B) SPECIAL CONDITIONS

1. Site condition: Work will be carried out at VECC, Kolkata.
2. Site should be cleaned after completion of work or as and when required.
3. The job is to be carried out during 09.00AM – 05.30PM on all working days as per availability of scope of work. However separate entry permit will be required to be got approved before taking up work on a holiday.
4. Contractor should have valid electrical contractor license and required work experience in similar kind of jobs after obtaining electrical license.
5. Documents including work experience certificates are provided by Contractor at the time tender may be verified from issuing authority after opening of the technical bid.
6. Prevailing security guidelines of VECC shall be strictly followed.
7. The Contractor shall obtain a Work Permit from the designated Safety Officer of VECC before commencing work. No work will be allowed without a valid work permit. The Contractor should comply with all safety procedure before the work permit is issued. Work Permit shall be kept with the Supervisor at site and should be produced on demand by the Safety Officer.
8. The work is to be carried out as required as per schedule of quantity.
9. Liquidated damages 0.5% per week subject to maximum 10% of the work order value to be computed for delay will be levied on you in case of delay beyond the stipulated completion period.
10. The original EMD should be sent well in advance to Head, Electrical Section, VECC Tel: 033 2318 4754 or Engineer-in-charge of the work, Tel: 033 2318 3159 to reach them before date & time of online opening of technical bid mentioned in PART-A of NIT, otherwise the uploaded bid will be rejected.

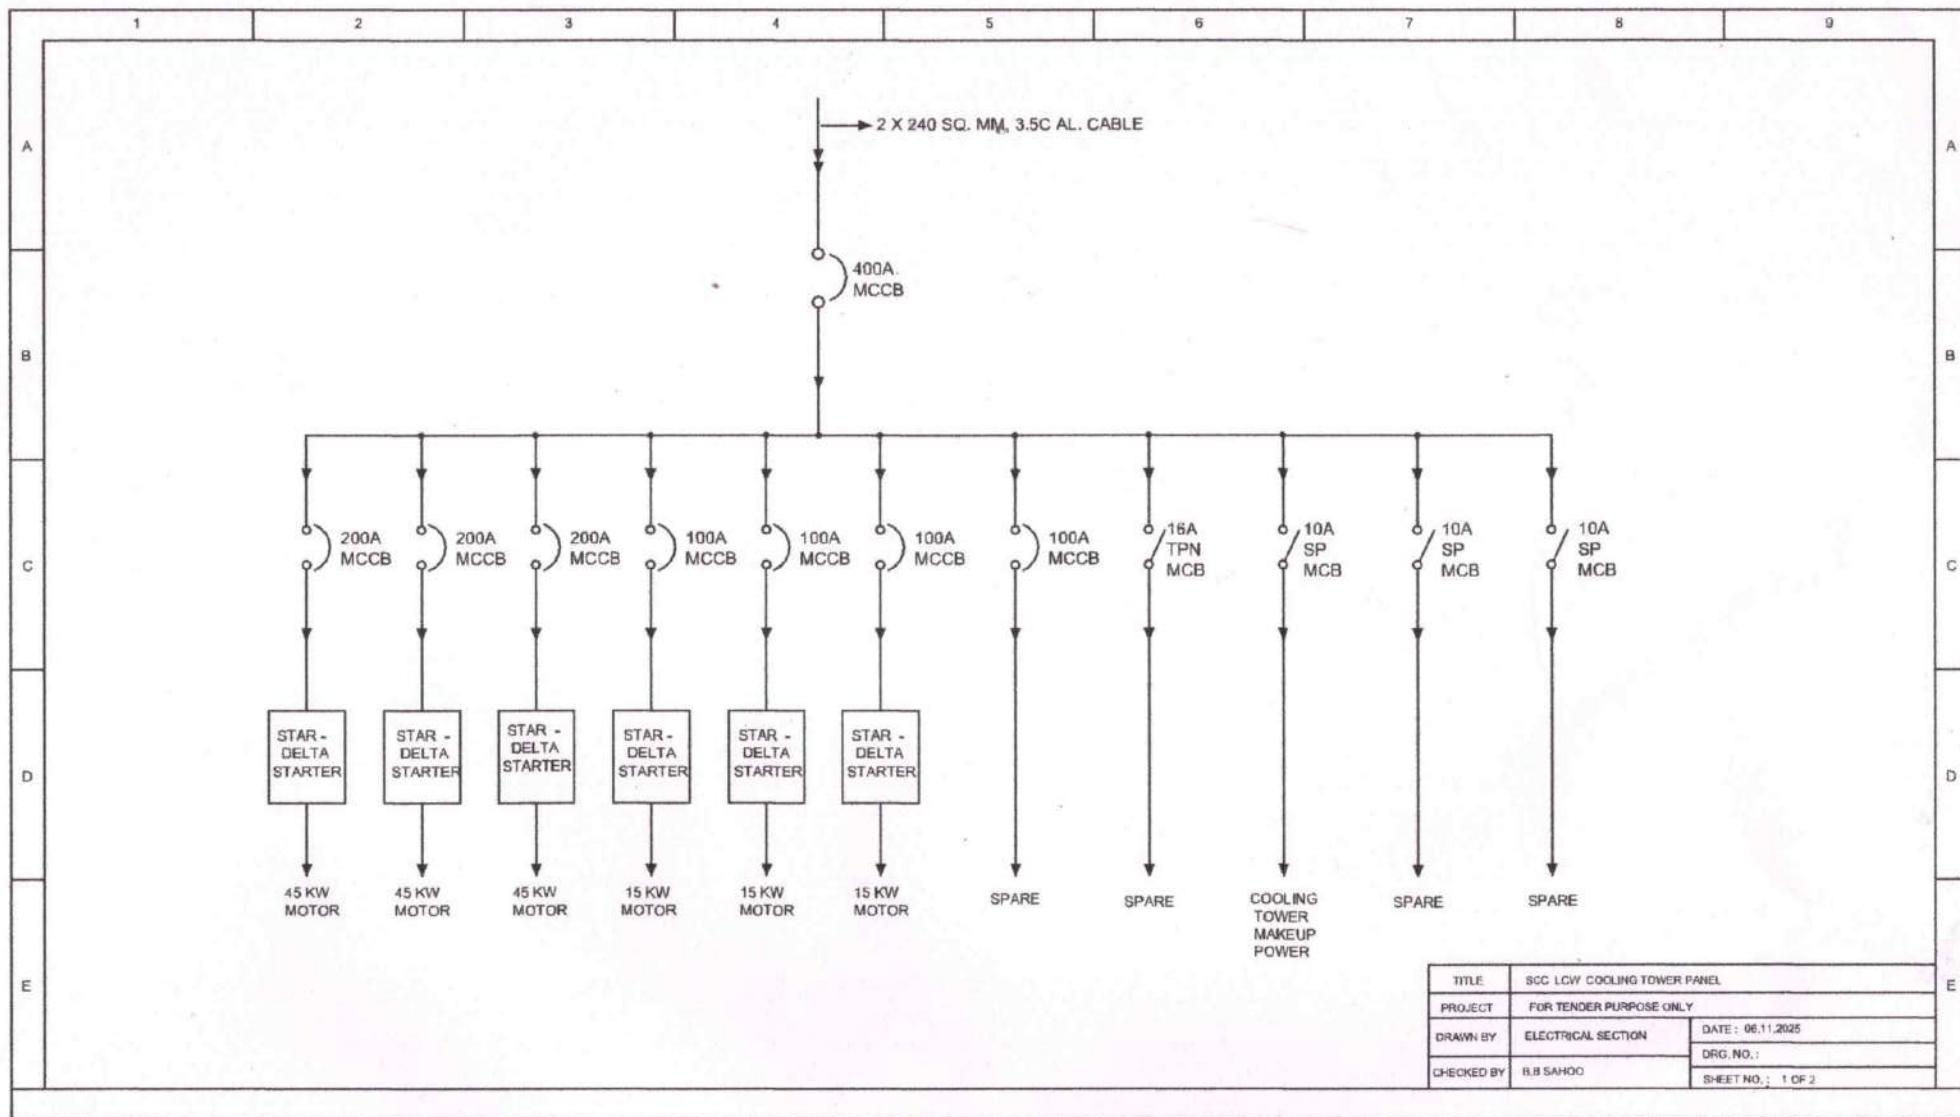

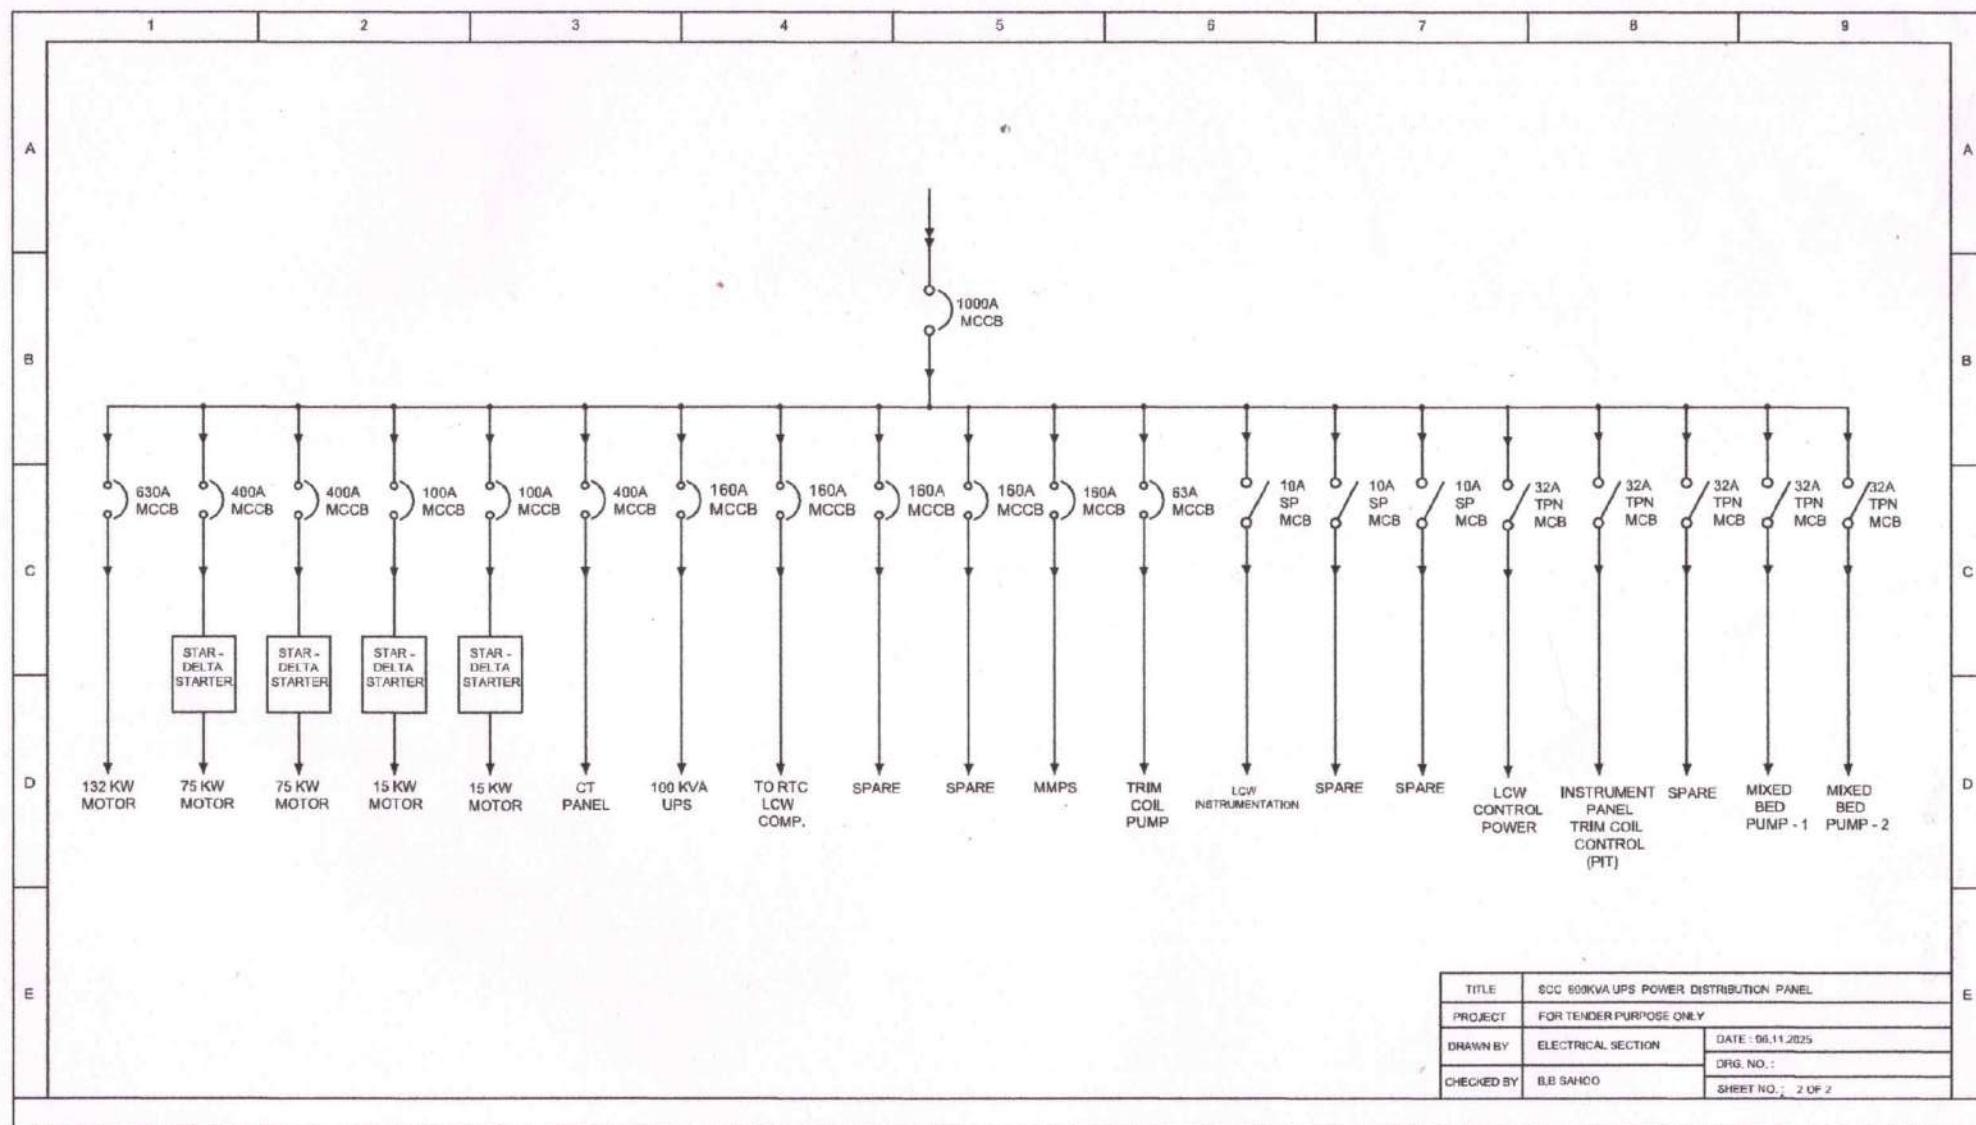

TITLE	SCC 600kVA UPS POWER DISTRIBUTION PANEL
PROJECT	FOR TENDER PURPOSE ONLY
DRAWN BY	ELECTRICAL SECTION
DATE :	06.11.2025

DRG. NO.:	
SHEET NO.:	2 OF 2

PART F: SALIENT GOVERNING FEATURES OF THE TENDER/ WORK

(Operative Schedules of Individual Tender)

Name of work: Supply installation of Electrical distribution panels for SCC LCW system in VECC.

NIT No: VECC/MEG/ES/NIT/25-26/B-64/37

DT: 07/01/2026

INDEX

REFE- RENCE	PARTICULARS	PAGE
1	SECTION – 2 : ITEM RATE TENDER & CONTRACT FOR WORKS	3-4
2	SCHEDULES	
A	Reference to NIT & Tender Documents	5
B	Schedule of materials to be issued to the contractor	5
C	Land earmarked for temporary infrastructures and Tools & plants to be hired to the contractor if any	5
D	Extra schedule for specific requirements / documents for the work, if any	5
E	Schedule of component of Cement, Steel, other Materials, Labour, POL etc. for price escalation.	5
F	VARIABLES IN CONDITIONS AND CLAUSES OF CONTRACT	
	Reference to book of conditions, work / project and NIT	6
	General rules & directions	6
	Definitions with reference to the particular project / work	6
	Clause-1: Time allowed for submission of Performance Guarantee from the date of issue of letter of acceptance / WO & Maximum allowable extension beyond the same	6
	Clause-2: Authority for fixing compensation under clause 2	6
	Clause-5: No. of days from the date of issue of WO for reckoning date of start.	6
	Table of Mile Stone(s)	6-8
	Clause-6 or 6-A: Applicability of Manual or Computerized billing	7
	Clause-7: Eligibility for interim payment	7
	Clause-10-A: List of testing equipment to be provided by the contractor at site lab	7
	Clause-10 B (ii): Applicability of payment of Mobilization Advance	7
	Clause-10 C: Component of labour in percent of value of work	7
	Clause-10 D: No escalation will be paid for this work	
	Clause-11: Specifications to be followed for execution of work	7
	Clause-12: Deviation limits for applicability of this clause 12.2, 12.3 & 12.5	7
	Clause-16: Competent Authority for deciding reduced rates	7
	Clause-18: List of mandatory machinery, tools & plants to be deployed by the contractor at site	7
	Clause-36(i): Requirement of Technical Representative(s) and recovery Rate	8
	Clause-42: Theoretical consumption of materials, permissible variation & Recovery	8
	Recovery rates for quantities beyond permissible variation	8

SECTION - 2 : ITEM RATE TENDER & CONTRACT FOR WORKS

i)	Name of work	Supply installation of Electrical distribution panels for SCC LCW system in VECC..
ii)	Bid submission end date & time	27/01/2026 15:00 h
iii)	Date & Time of online opening of technical bid	In presence of tenderers who may be present on 28/01/2026 15:30 h

TENDER

I / We have read and examined the Notice Inviting Tender, Salient Governing Features of the Tender / Work including Schedules A, B, C, D, E & F, **Specifications Books** *, Drawings and Designs, General Rules & Directions, General Clauses of Contract, Special Clauses of Contract & other documents and rules referred to in the **Conditions and Clauses of Contract – 2008** * and all other contents in the tender documents for the work.

(* Note: The "Specifications / Conditions and Clauses of Contract books" are available on departmental Web-site www.vecc.gov.in. The required books as indicated under Schedule "F" and under Clause-11 of this Salient Governing Feature of the Tender / Work, may be downloaded from the VECC's Web-site4. If the agency already possesses or has downloaded this / these book(s), they need not purchase the same again:

SN	NAME OF DOCUMENT	
1	Conditions and Clauses of Contract – 2008	

However, these books, as required / specified in this "Salient Governing Feature of the Tender / Work" herein below, shall remain part of the tender documents / Contract / agreement to be executed, and signed by both the parties after acceptance of the Tender.)

I / We, hereby tender for the execution of the work specified for the President of India within the time specified in Schedule "F", viz., Schedule of Quantities and in accordance in all respects with the specifications, designs, drawings and instructions in writing referred to in Rule 1 of General Rules and Directions and in Clause - 11 of the General Clauses of Contract and with such materials as are provided for, by, and in respects in accordance with, such conditions so far as applicable.

Such materials as are provided for, by, and in respects in accordance with, such conditions as far as applicable.

We agree to keep the tender open for **one hundred twenty (120) days** from the last date of its submission and not to make any modifications in its terms and conditions.

A sum of **₹ 38,000.00** (Rupees Thirty-eight thousand only) shall be deposited as Earnest Money as per stipulations in the NIT / Tender documents in the required format on demand from the Government. Consequent to the award of the subject work, if I / we fail to commence work as specified, I / we agree that President of India or his successors in office shall without prejudice to any other right or remedy available in law, be at liberty to forfeit the said earnest money, otherwise the said earnest money shall be retained by him towards security deposit to execute all the works referred to in the tender documents upon the terms and conditions contained or referred to therein and to carry out such deviations as may be ordered, upto maximum of the percentage mentioned in Schedule "F" and those in excess of that limit at the rates to be determined in accordance with the provision contained in Clause 12.2 and 12.3 of the tender form. Further, I / We agree that in case of forfeiture of earnest money as aforesaid, I / We shall be debarred for participation in the re-tendering process of the work.

I / We hereby declare that I / We shall treat the tender documents, drawings and other records connected with the work as secret / confidential documents and shall not communicate information / derived therefrom to any person other than a person to whom I / We am / are authorized to communicate the same or use the information in any manner prejudicial to the safety of the State.

Signature of Contractor
Postal Address

Dated

Witness

Address

Occupation

ACCEPTANCE

The above tender (as modified by you as provided in the letters mentioned hereunder) is accepted by me for and on behalf of the President of India for a sum of ₹...../- (Rupees.....
.....).

The letters referred to below shall form part of this contract Agreement.

- i)
- ii)
- iii)

Signature
Designation

For & on behalf of the President of India

Dated

Proforma of Schedules

SCHEDULE 'A'			
SCHEDULE 'A' Reference to NIT & Tender Documents			
SN	TITLE	PARTICULARS	
1	TENDER NOTICE NO.	VECC/MEG/ES/NIT/25-26/B-64/37 DT: 07/01/2026	
2	Notice Inviting Tender details	i) NIT as uploaded on Web Site, www.vecc.gov.in ii) NIT as published in Notice Board	
3	Scope and location of the work:	Enclosed	
4	List of drawings	NIL	
5	Time Schedule for the work:	120 Days	
6	List of changes if any in specifications:		
7	Schedule of Quantities -	(Enclosed)	

SCHEDULE 'B'				
Schedule of materials to be issued to the contractor: Not applicable for this work				
S. No	Description of item	Quantity	Rates at which the Materials will be charged to the contractor	Place of issue
1.	Water		Water will be supplied by the Department free of cost	
2.	Electricity		Electricity consumed for this work shall be supplied by the Department free of cost.	

SCHEDULE 'C'			
Land earmarked for temp. infrastructures and Tools & plants to be hired to the contractor :			
S.No	Description	Hire charges	Place of issue
1.	Area for storage / site office	As per Clause	Site premises
2.	Temporary Buildings	As per Clause	Not Applicable.
3.	Labour hutments	No labour hutment permitted at site	
4.			

SCHEDULE 'D'			
Extra schedule for specific requirements / documents for the work, if any	Particularly for Security guidelines, Gate pass, lift, tower crane etc,	Prevailing security regulation shall be strictly adhered to	

SCHEDULE 'E'			
Schedule of component of Cement, Steel, other Materials, Labour, POL etc. for price escalation		Not applicable for this work	

SCHEDULE 'F' VARIABLES IN CONDITIONS AND CLAUSES OF CONTRACT

Reference to the Book of "Conditions & Clauses of Contract" to be followed for this work	2008
Name of Work	As per NIT
Estimated cost of work :	₹ 19,00,000.00
i) Earnest money	₹ 38,000.00
ii) Performance Guarantee	5% of tendered value
iii) Security Deposit	2.5% of gross value of work done
	As per Tender

General Rules & Directions :	
Tender inviting authority	<i>Director, VECC.</i>
Maximum percentage for quantity of Items of work to be executed beyond which rates are to be determined in accordance with Clauses 12.2 & 12.3	See Clause-12 below

Clause - 1	
i) Time allowed for submission of Performance Guarantee from the date of issue of letter of acceptance / WO	15 days
ii) Maximum allowable extension beyond the period (provided in- i) above with a late fee @ 0.1% per day, maximum 10% of the PBG value computed on actual period of delay.	15 days

Clause - 2	
Authority for fixing compensation under clause 2	<i>Director, VECC.</i>

Clause - 5			
Number of days from the date of issue of letter of acceptance / WO for reckoning date of start			15 days
Mile stone(s) as per table given below:			
TABLE OF MILE STONE(S)			
Sl. No.	Description of Milestone (Physical)	Time Allowed in days (from date of start)	Amount to be withheld in case of non-achievement of milestone
1.	<u>NIL</u>		
2	<u>NIL</u>		

TIME ALLOWED FOR EXECUTION OF WORK	Four (4) Months (as per NIT)
---	-------------------------------------

Clause – 6 & 6A	Clause 6 for manual billing Clause 6A for computerized billing	As per clause 6 for manual billing & MB (Measurement Book)
----------------------------	---	--

Clause – 7 / Eligibility for interim payment.		
Gross work to be done together with net payment / adjustment of advances for material collected, if any, since the last such payment for being eligible to interim payment		Quarterly or value of work done is more than 10 lakhs whichever is earlier.

Clause - 10A	: Not applicable for this work

Clause - 10B(ii) (Mobilization Advance) – Not applicable for this work	
Whether Clause 10 B (ii) shall be applicable (If yes, Clause of Tender Condition to be followed)	No

Clause - 10C	
Component of labour expressed as percent of value of the work	30%
CLAUSE 10 D:	
Clause - 11	
Specifications to be followed for execution of this work	Specifications as per attachment

Clause – 12		
12.2 & 12.3	Deviation limited beyond which this clauses	50%
Clause - 16		
Competent Authority for deciding reduced rates		Director, VECC.
Clause - 18		
List of mandatory machinery, tools & plants to be deployed by the contractor at site:		
NIL		

Clause – 36(i)		Requirement of Technical Representative(s) and recovery Rate					
Sl. No.	Minimum Qualification of Technical Representative	Discipline	Designation (Principal Technical / Technical representative)	Min. Exp . In yrs.	No	Rate per month at which recovery shall be made from the contractor in the event of not fulfilling provision of clause 36(i).	Remarks
						N.A.	

Note: Pro-rata deduction can be made: NA

Clause - 42		
(i)	Variations permissible for materials issued	NA
(ii)		

RECOVERY RATES FOR QUANTITIES BEYOND PERMISSIBLE VARIATION: Not Applicable

S. No.	Description of Item	Rates in figures & words at which recovery shall be made from the Contractor	
		Excess beyond permissible variation	Less use beyond the permissible variation
1	Refer Schedule -A	NA ...% above market rate	Nil

Notes:

1. In the case of any discrepancy between these “Salient Governing Features of the Tender/Work” & the book “Conditions and Clauses of Contract – 2008”, stipulations given in these “Salient Governing Features of the Tender/Work” shall take precedence.